

Development of a Cost Model for Membrane Bioreactors Including Sludge Handling Costs

Jana Schaller*, Anja Drews** and Matthias Kraume*

* Chair of Chemical and Process Engineering, Technische Universität Berlin, Ackerstraße 71-76, Sekr. ACK 7, 13355 Berlin, Germany, Tel.: +49 30 314 23701, Fax: + 49 30 314 21134, E-mail: J.Schaller@tu-berlin.de

** HTW Berlin, Engineering II, School of Life Science Engineering, Wilhelminenhofstr. 75A, 12459 Berlin, Germany, Tel.: +49 30 5019 3309, Fax: +49 30 5019 2125, E-mail: anja.drews@htw-berlin.de

Abstract

Membrane bioreactors are state of the art in municipal wastewater treatment. One of their main disadvantages is the high energy demand for air scour of the membrane. However, due to more stringent legal restrictions, sludge handling costs will increase and therefore they are becoming more and more significant for the total operating cost of the MBR. In this study, a novel cost model approach for immersed membrane bioreactors treating municipal wastewater incorporating the energy demand for aeration and fouling prevention as well as the related sludge handling costs subject to local conditions is presented. The model is consciously kept simple to be easily applicable for end-users and is based on a few easily accessible input parameters like operational (HRT, SRT) and bio-kinetic parameters (yield, decay coefficient) and feed conditions. Information on bio-kinetic parameters and oxygen transfer efficiency varies strongly in the literature; therefore the correct choice of these parameters is essential for an applicable model to avoid the over- or underestimation of the impact of aeration on the system. In first simulation and sensitivity studies, the derived framework was found to be appropriate to predict the total costs of an immersed MBR.

Keywords

MBR modelling, dewatering, aeration, costs

INTRODUCTION

In the last decade, membrane bioreactor (MBR) technology has advanced from a pure research topic to a substantial alternative for conventional wastewater treatment plants. However, one of the main disadvantages of MBRs is the high energy demand for air scour of the membrane, but due to more stringent legal restrictions, sludge handling costs will increase [1] and they are therefore also becoming more and more important for the total operating cost of the MBR. Consequently, the currently assumed optimal MLSS concentration will shift to higher values and a new optimisation is necessary. The costs for sludge disposal vary strongly depending on the method used, on local conditions, like plant size, plant equipment, local regulations, transportation costs and sludge characteristics like dewaterability. Therefore, the operating conditions of each individual MBR should be selected carefully to minimise the overall costs.

Most of the cost models found in literature just consider the energy demand for aeration of the biology, fouling prevention, pumping etc. as the main factor influencing the operational costs. Just the model by Yoon et al. [2] include the sludge handling costs using a fixed value for the sludge treatment, however, this model does not include a sub-model for fouling prevention. To set-up a model for the whole MBR process the following submodels are needed:

- (i) model for sludge growth
- (ii) aeration model for biological processes
- (iii) aeration model for fouling prevention
- (iv) sludge treatment model including excess sludge properties models and disposal models

Biological modelling of MBR processes was investigated intensely in the last years. Normally these models are based on the ASM models [2-5] and are sometimes extended by SMP concepts for a

better description of simultaneous fouling and higher SRT operation [6-8]. The applicability of ASMs for modelling MBRs and the set of parameters used, however, still needs to be verified to further understand the effects of higher SRTs and MLSS concentrations on biomass growth [9].

The energy demand for aeration is comprised of the aeration demand for biotreatment by fine bubble aeration and the membrane aeration for fouling prevention typically by coarse bubble aeration which is calculated separately [10, 11]. Furthermore, according to Krause and Cornel [10], the coarse bubble aeration already provides a portion (4-25%) of the dissolved oxygen for the biotreatment. They assumed that on average 15% of the oxygen demand for biotreatment can be attained through coarse bubble aeration.

Sludge handling models are very rare in literature [12]. Normally just a fixed cost value is assumed for sludge treatment including all treatment steps like dewatering, transport and incineration.

Additionally, several case studies on the optimisation of full scale MBRs are reported in literature [13-15]. These optimisations are done for particular local conditions at each plant and thus cannot be transferred easily to other MBRs, and also do not consider sludge handling and treatment.

In this study, a cost model for submerged membrane bioreactors treating municipal wastewater incorporating energy demand for aeration and fouling prevention as well as sludge handling costs subject to local conditions is presented, which will enable for each individual MBR the identification of the best operational parameters in terms of total operating costs.

MODEL DEVELOPMENT

The idea of this study is to set up cost model for municipal MBRs, which is consciously kept simple to be easily applicable for end users. It is based on a few easily accessible input parameters like operational (HRT, SRT) and bio-kinetic parameters (yield, decay coefficient) and feed conditions. In Figure 1 the scheme of the cost model with the different sub-models and their interrelation is shown.

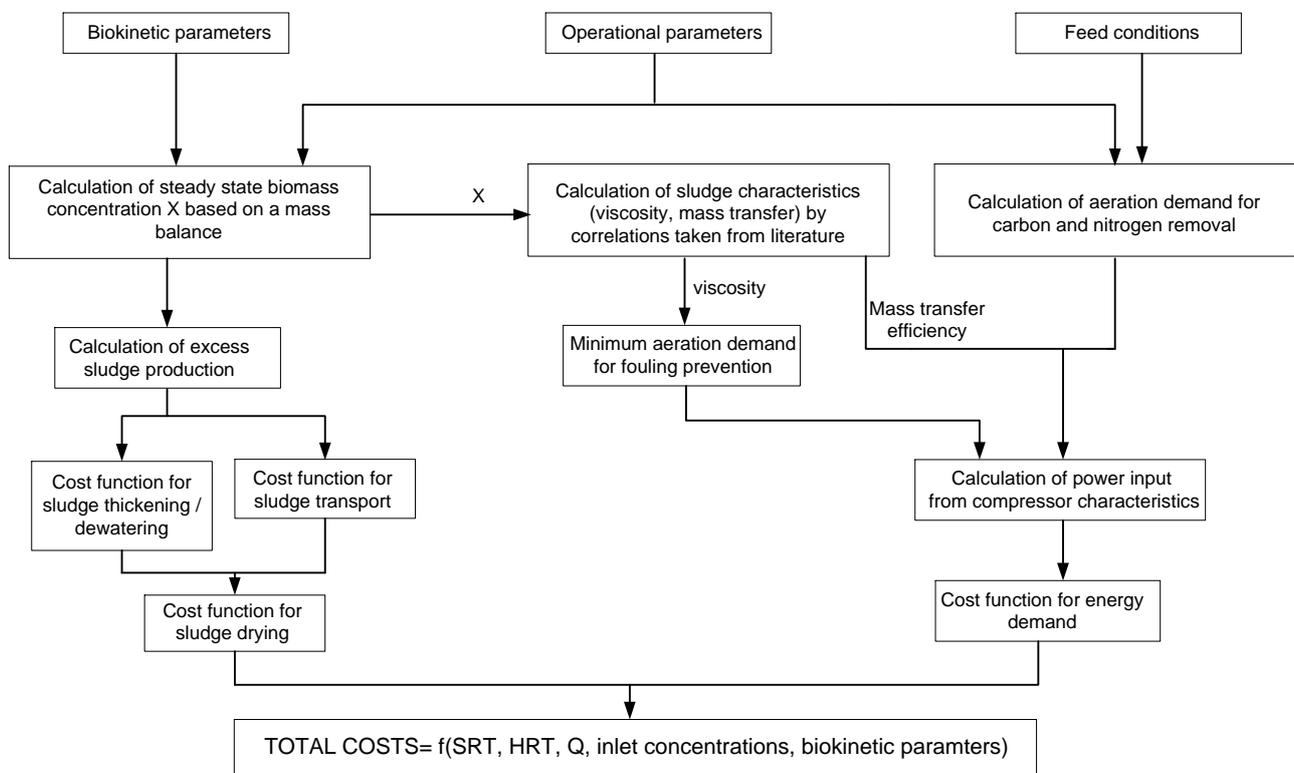


Figure 1. Scheme of the cost model

Sludge Production Model

The steady state biomass concentration in the membrane bioreactor is calculated from a mass balance on sludge and substrate in the reactor (ASM1) [4, 5].

$$V \frac{dX}{dt} = Y \frac{\mu_{\max} \cdot S}{K_s + S} \cdot X \cdot V - b \cdot X \cdot V - Q_w \cdot X \quad (1)$$

$$V \frac{dS}{dt} = - \frac{\mu_{\max} \cdot S}{K_s + S} \cdot X \cdot V + Q \cdot S_0 - Q \cdot S \quad (2)$$

Assuming that the bioreactor is completely mixed, the biomass concentration at steady state conditions can be derived by rearranging Eq. (1) and (2) and solving for X.

$$X = \frac{1}{HRT} \cdot (S_0 - S) \cdot \frac{Y \cdot SRT}{1 + b \cdot SRT} \quad (3)$$

i.e., biomass concentration in the MBR is just a function of operating parameters (SRT, HRT), inlet conditions (S_0) and biokinetic parameters (Y, b). Operating parameters and inlet conditions are well known, so only the biokinetic parameters have to be determined experimentally or taken from literature.

With a known sludge age SRT and the biomass concentration X, the excess sludge production can be calculated using equation (4):

$$ESP = \frac{V \cdot X}{SRT} = \frac{Y \cdot Q}{1 + b \cdot SRT} \cdot (S_0 - S) \quad (4)$$

Aeration Model

The theoretical aeration demand to maintain the biological process is calculated according to ATV-DVWK-A 131 [16] considering the oxygen requirement for carbon and nitrogen removal. To keep a constant oxygen concentration C_{set} of 2 mg L⁻¹ in the reactor, the real aeration demand is then calculated considering the oxygen transfer efficiency α and the blower efficiency η .

$$Q_{air,real} = \frac{C^*}{C^* - C_{set}} \cdot Q_{air,theoret.} \cdot \frac{1}{\alpha \cdot \eta} \quad (5)$$

The oxygen transfer efficiency α is a function of MLSS concentration and can be calculated according to different correlations found in literature [17-19]. The blower efficiency can be taken from data sheets. The power demand is then calculated using the correlation established by Krause and Cornel [10] with $E_{pot} = 5.44 \text{ Wh m}^{-3} \text{ m}^{-1}$ and the depth h of the aeration device.

$$P_{biology} = E_{pot} \cdot Q_{air,real} \cdot h \quad (6)$$

According to Cornel and Krause [20], the aeration demand for fouling prevention varies between 0.4 and 1 kWh m⁻³ for immersed membranes. In a first approach, a linear relationship between power demand for fouling prevention and the constant viscosity μ_{∞} at a high shear rate of 2300s⁻¹ was assumed in this study.

$$P_{fouling} = 0.0375 \cdot \mu_{\infty} + 0.325 \quad (7)$$

The coefficients of equation 7 were determined by correlating own measurements of the viscosity μ_{∞} at a given MLSS concentration with the power input. Furthermore, the coarse bubble aeration already provides a portion (15%) of the dissolved oxygen for the biotreatment [10].

Sludge Handling Model

The cost models for sludge thickening and transport are specific for each plant, due to different on-site sludge handling availabilities, and thus they must be adapted for each case. In a first approach,

constant sludge treatment costs of 200 - 800 € t_{DS}^{-1} are assumed [21]. This sub-model has to be refined in a next step.

SENSITIVITY ANALYSIS

In order to evaluate the derived model, simulation studies and sensitivity analyses were carried out. In a first step, a plausibility check with the different sub-models was realised. According to Equation 3, biomass concentration in the MBR can be calculated. Information about operating conditions and the influent parameters are easily accessible for each plant, but information about biokinetic parameters are less precisely known because they are strongly dependent on operating conditions and have to be determined experimentally or taken from literature. Therefore, the effect of a varying yield coefficient on steady state biomass concentration is shown in Figure 1, initially assuming that the yield coefficient is independent of SRT. Yield coefficients obtained from literature [3, 22] vary between 0.38 – 0.13 mgVSS mgCOD⁻¹ for sludge ages from 5-110 days. Own measurements for a sludge age of 75 d resulted in a yield coefficient of 0.228 mgMLSS mgCOD⁻¹. It is obvious that an inaccurate yield coefficient can result in an error of up to 50% in the determination of MLSS. Therefore, a correlation for biokinetic parameters as a function of operating conditions needs to be implemented in the model.

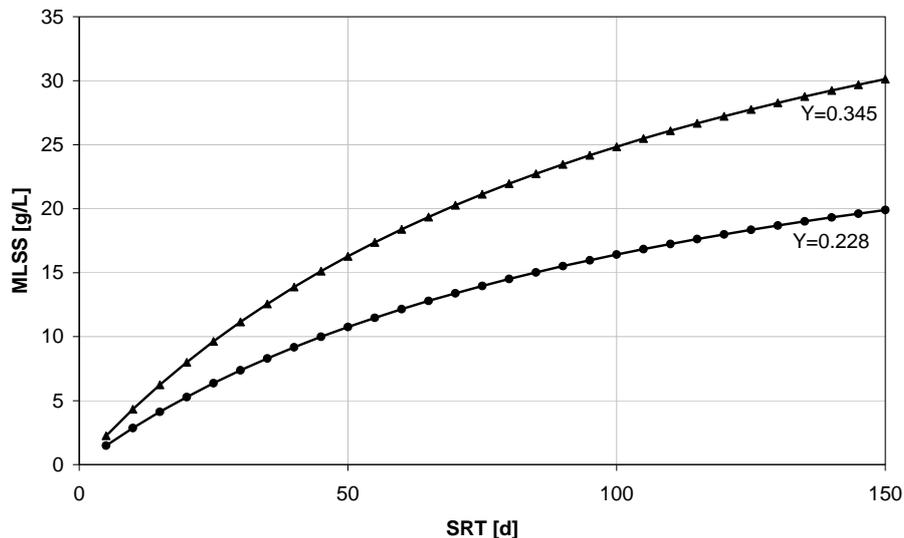


Figure 1. Biomass concentration in the reactor depending on sludge age assuming a constant yield coefficient ($b=0.009 \text{ d}^{-1}$, $\text{HRT}=10 \text{ h}$, $S_0=600 \text{ mgCOD L}^{-1}$, $S=30 \text{ mgCOD L}^{-1}$)

According to Eq. (3) MLSS concentration changes linearly with yield coefficient and influent substrate concentration ($S_0 \gg S$) and it is inversely proportional to HRT.

Table 1. Parameters of a bench-scale MBR used for the simulation

<i>Operational parameters</i>		<i>Influent conditions</i>	
Q [$\text{m}^3 \text{ d}^{-1}$]	0.096	S_0 [mg L^{-1}]	600
HRT [h]	10	S [mg L^{-1}]	30
F/M [kgCOD d^{-1}]	0.0576	TN [mg L^{-1}]	80
T [$^{\circ}\text{C}$]	14		
C_{set} [mg L^{-1}]	2	<i>Biokinetic paramters</i>	
ρ_{air} [kg m^{-3}]	1.225	Yield [mgVSS mgCOD^{-1}]	0.228
		b [d^{-1}]	0.009

Further simulation studies were performed with the values given in Table 1. The operational conditions and the bio-kinetic parameters were taken from a bench-scale MBR for carbon and nitrogen removal operated in our laboratory at an SRT of 75 days with a complex synthetic wastewater [23]. The influent concentration S_0 and TN are average values from the plant and the effluent concentration was calculated assuming 95% removal efficiency.

In Figure 2, the real aeration demand to maintain the biological process was determined using different α correlations taken from literature [17-19] and assuming a blower efficiency of 50%. With increasing SRT, the difference between the aeration demands increases up to 60%. It is obvious that the big differences in the calculated aeration demand especially for high sludge age result in a significant difference in aeration costs. Therefore, oxygen transfer for higher MLSS concentrations should be investigated more intensively to get an improved knowledge of the parameters influencing oxygen transfer.

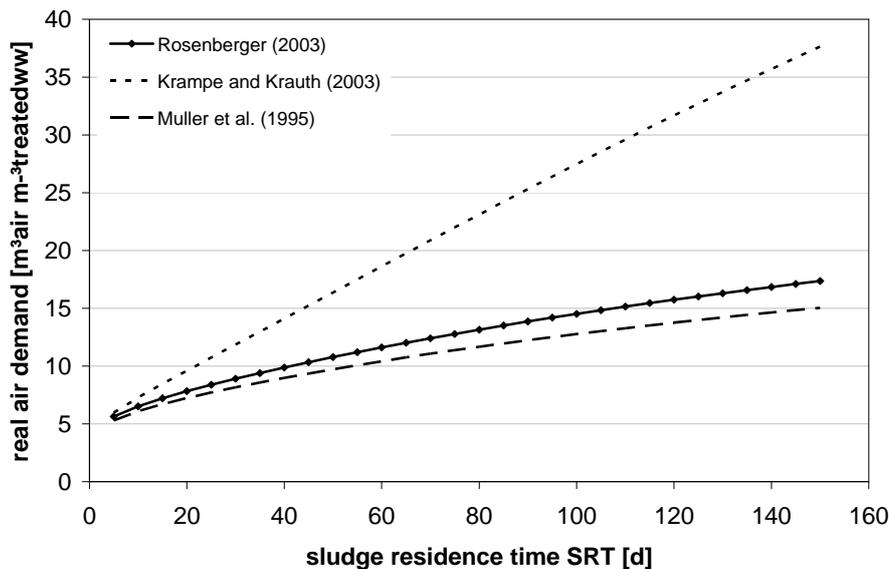


Figure 2. Calculated aeration demand to maintain the biological process with different α correlations assuming a blower efficiency of 50%

COST CONSIDERATIONS

The costs of an MBR process vary strongly depending on local conditions due to differences in the electricity tariff and sludge treatment depending on the method used and on local conditions like plant size, equipment, local regulations, transportation costs and sludge characteristics.

In Figure 3, the total aeration costs for the biology and fouling prevention as well as the sludge treatment costs per m^3 treated wastewater versus sludge age are shown, assuming different electricity tariffs and sludge treatment cost, respectively. The total aeration costs were calculated with the parameters given in Table 1, the α correlation found by Rosenberger [19], a blower efficiency of 50% and the assumption that the coarse bubble aeration for fouling prevention provides 15% of the aeration demand to maintain the biological process (see above). Total costs in the range of 10c/ m^3 have been reported [24] which shows that the model yield realistic values.

Increasing the sludge treatment costs by 40% from 500 $\text{€}t_{DS}^{-1}$ to 700 $\text{€}t_{DS}^{-1}$ at constant electricity costs of 10 €cents kWh^{-1} will result in an increase of the total operation cost by 10-25% depending on sludge age. The strongest increase is observed for decreasing sludge ages. An increase in the electricity tariff by 25% at constant sludge treatment costs results in an increase of 10-18% of total operating costs. The increase is more pronounced for higher sludge ages. At a given combination of sludge treatment costs and energy costs the total costs per m^3 treated wastewater do not vary

significantly. Nevertheless, a minimum of total costs can still be observed at different sludge ages depending on local costs. In the 3 combinations shown in Figure 3, the optimal SRT varies between 50 and 100 days. Therefore the model can be used to optimise the sludge age for a given MBR plant.

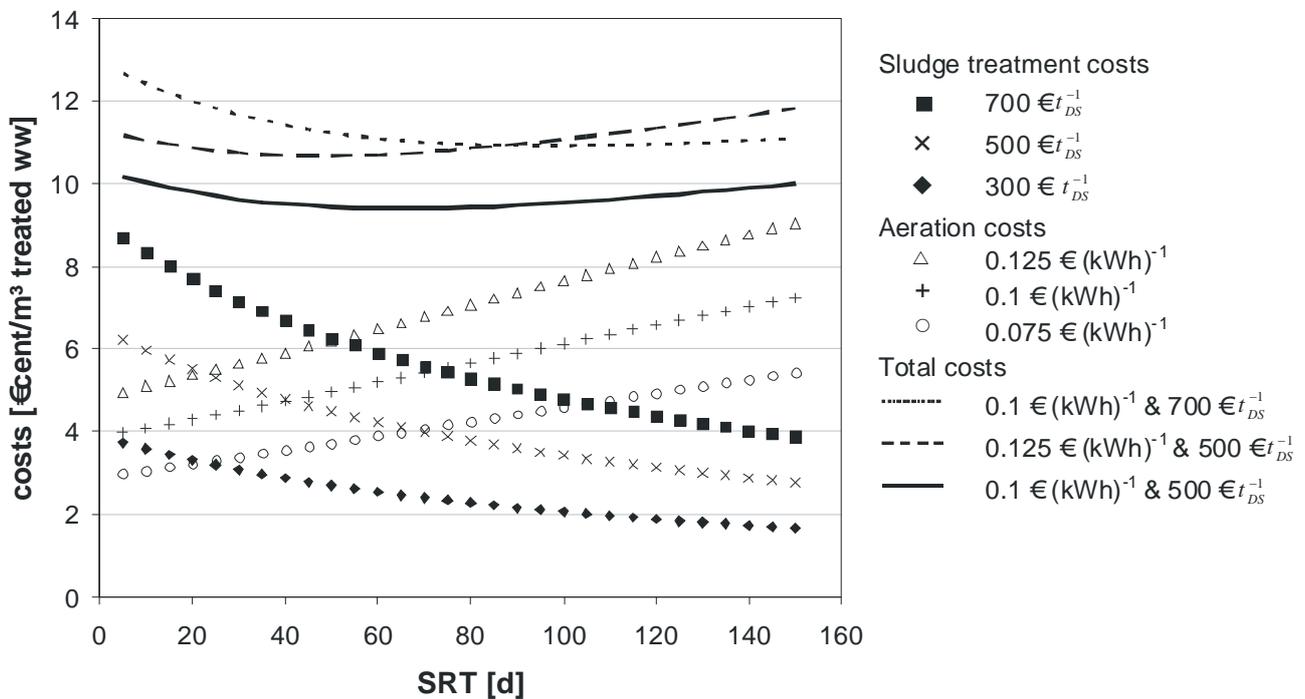


Figure 3. Calculated costs per m^3 treated wastewater for aeration and sludge treatment versus sludge age assuming different electricity tariffs and sludge treatment cost, respectively

CONCLUSION

In this study, a novel cost model approach for immersed membrane bioreactors treating municipal wastewater is presented which incorporates energy demand for aeration and fouling prevention as well as the related sludge handling costs subject to local conditions. The model presented is consciously kept simple. It is suitable for MBR users and is based on a few easily accessible input parameters like operational (HRT, SRT) and bio-kinetic parameters (yield, decay coefficient) and feed conditions. The information on bio-kinetic parameters and oxygen transfer efficiency vary strongly in literature, therefore the correct choice of these parameters is essential for an applicable model.

The different sub-models were validated and a sensitivity analysis was performed to determine significant parameters on operating costs. In first simulation studies, the model was found to be appropriate to predict the total costs of an immersed MBR. It was shown that depending on local sludge treatment costs and electrical costs the optimal sludge age varies strongly between 50 and 100 days. Therefore the model can be used to identify the best SRT for each individual MBR.

Nevertheless, some improvements need to be made for the model to be more universally valid. Especially the information of bio-kinetic parameters as a function of sludge age is needed to yield a reliable prediction of the biomass concentration. Furthermore, the sludge treatment costs have to be modelled in greater detail splitting them into costs for transport, sludge thickening and dewatering and maybe also other sludge treatment routes like anaerobic digestion.

ACKNOWLEDGMENT

The authors wish to thank the European Commission for the financial support. The study was performed within the European project – “REMOVALS” (FP6 – contract n° 018525).

LIST OF SYMBOLS

b	decay coefficient [d^{-1}]	S	COD concentration influent [$mg L^{-1}$]
C^*	oxygen saturation concentration [$mg L^{-1}$]	S_0	COD concentration effluent [$mg L^{-1}$]
C_{set}	Oxygen conc. in aerated tank [$mg L^{-1}$]	SRT	Sludge retention time [d]
E_{pot}	Potential energy [Wh]	t	Time [d]
ESP	Excess sludge production [$g h^{-1}$]	T	Temperature [$^{\circ}C$]
h	Depth of aeration device [m]	V	Volume [m^3]
HRT	Hydraulic retention time [h]	X	Biomass concentration [$mg L^{-1}$]
K_s	Half saturation constant [$mg L^{-1}$]	Y	Yield coefficient [$mgVSS mgCOD^{-1}$]
P	Power demand [kW]	α	Dimensionless oxygen transfer coefficient [-]
Q	Influent flow rate [$m^3 h^{-1}$]	η	Blower efficiency [-]
Q_w	sludge flow rate [$m^3 h^{-1}$]	μ_{max}	Maximum specific growth rate [d^{-1}]
Q_{air}	Air flow rate [$m^3 h^{-1}$]	μ_{∞}	Infinite viscosity [mPas]

REFERENCES

- [1] S. Saby, M. Djafer, G.H. Chen, *Water Res.* 37 (2003) 11-20.
- [2] S. H. Yoon, H. S. Kim, I.T. Yeom, *Water Res.* 38 (2004) 37-46.
- [3] M. Spérandio, M.C. Espinosa, *Desalination* 231 (2008) 82-90.
- [4] T. Wintgens, J. Rosen, T. Melin, C. Brepols, K. Drensla, N. Engelhardt, *J. of Membr. Sci.* 216 (2003) 55-65.
- [5] C.-H. Xing, W.-Z. Wu, T. Qian, E. Tardieu, *J. of Environ. Eng.* 129 (2003) 291-297.
- [6] J. Cho, K. H. Ahn, Y. Seo, Y. Lee, *Wat. Sci. Technol.* 47 (2003) 177-181.
- [7] Y. Lee, J. Cho, Y. Seo, J.W. Lee, K.H. Ahn, *Desalination* 146 (2002) 451-457.
- [8] S. G. Lu, T. Imai, M. Ukita, M. Sekine, T. Higuchi, *Water Sci Technol* 46 (2002) 63-70.
- [9] N. L. Ng, A. S. Kim, *Desalination* 212 (2007) 261-281.
- [10] S. Krause, P. Cornel, *Chemie Ingenieur Technik* 76 (2004) 313-316.
- [11] B. Verrecht, S. Judd, G. Guglielmi, C. Brepols, J.W. Mulder, *Water Res.* 42 (2008), 4761-4770.
- [12] C. P. Chu, D. J. Lee, C.Y. Chang, *Water Res* 39 (2005) 1858-1868.
- [13] A. Garcés, W. De Wilde, C. Thoeye, G. De Gueldre, 4th IWA Conference on membranes for water and wastewater treatment, Harrogate 15-17 May 2007.
- [14] E. Giraldo, A. Mercer, M. Kean, 4th IWA Conference on membranes for water and wastewater treatment, Harrogate 15-17 May 2007.
- [15] C. Brepols, H. Schäfer, N. Engelhardt, *Aquatech*, Amsterdam 1-3 Oct. 2008.
- [16] ATV-DVWK (2000). *Arbeitsblatt ATV - DVWK - A 131*. GFA.
- [17] J. Krampe, K. Krauth, *Wat. Sci. Technol.* 47 (2003) 297-303.
- [18] E.B. Muller, A.H. Stouthamer, H.W. van Verseveld, D.H. Eikelboom, *Water Res.* 29 (1995) 1179-1189.
- [19] S. Rosenberger, PhD Thesis, TU Berlin, *Fortschr.-Ber. VDI Reihe 3 Nr. 769*, VDI Verlag, Düsseldorf (2003).
- [20] P. Cornel, S. Krause, *Wat. Sci. and Technol.* 53 (2006) 37-44.
- [21] J. Hall, *Proc. of the workshop on "Problems around sludge"*, Stresa (Italy) 18-19 Nov. 1999.
- [22] X. Wen, C. Xing, Y. Qian, *Process Biochemistry* 35 (1999) 249-254.
- [23] J. Schaller, M. Camacho, A. Drews, M. Kraume, *Book of Abstracts of SIDISA08*, Florence 24-27 June 2008.
- [24] B. Verrecht, G. Guglielmi, J.W. Mulder, C. Brepols, S. Judd, *Final MBR-Network Workshop*, Berlin 31 March-1st April 2009.